




ISSUE	ALTERATIONS	DRAWN	APP'D	MOD No.	DATE
1	S6000 NO 16 WAY BOARD NOTE ADDED	P.Garnett	SB	A5260	7-6-00

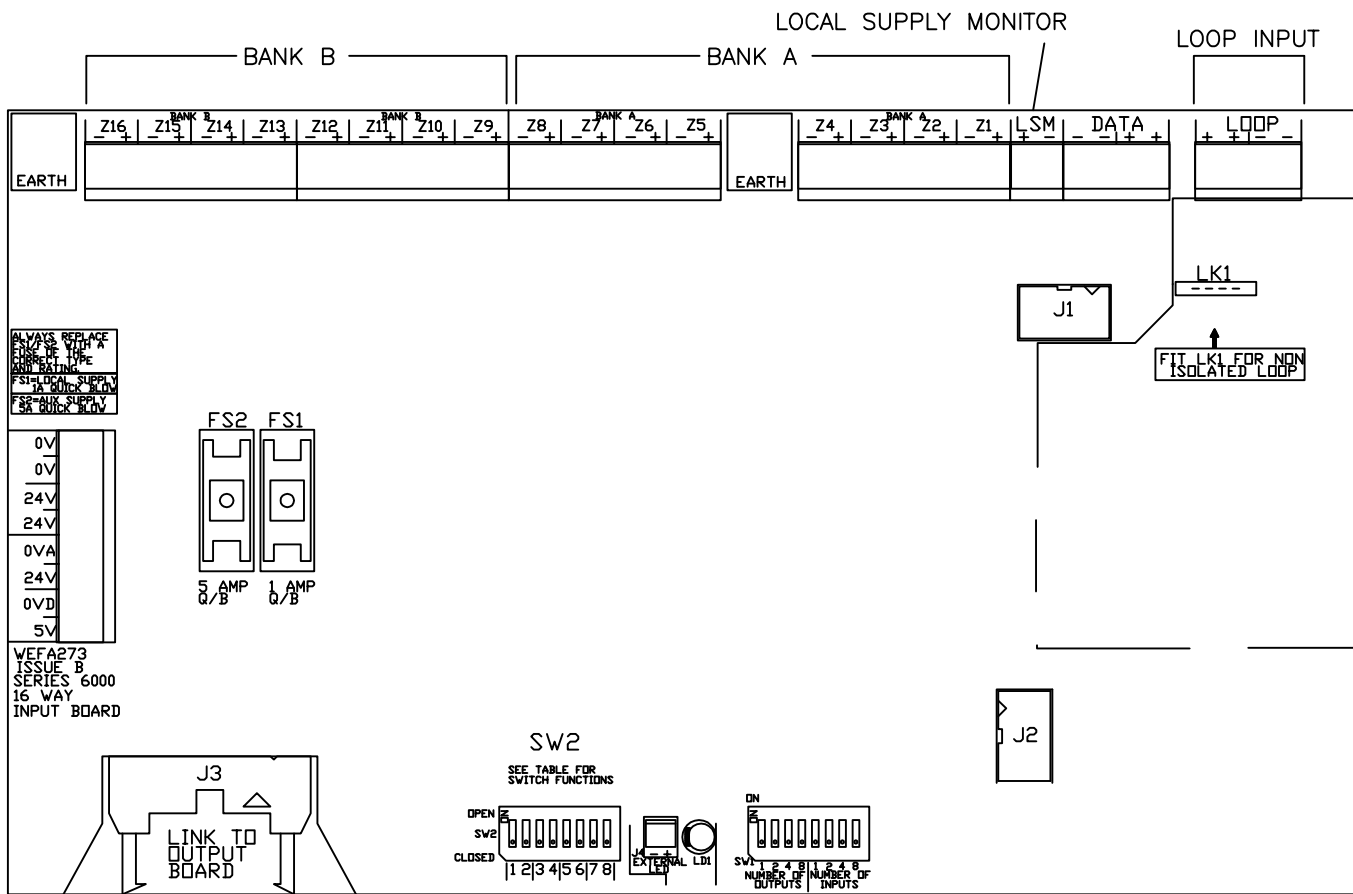

BOARD CONFIGURATION (SW2 FUNCTION) TABLE

#	FUNCTION	OPEN	CLOSED
1	O/P BOARD MONITORING	DISABLED	ENABLED
2			
3	BANK B FIRE CONDITION	NON LATCHING	LATCHING
4	BANK A FIRE CONDITION	NON LATCHING	LATCHING
5	BANK B MONITORING	RESISTIVE	CAPACITIVE
6	BANK B SPRINKLER DELAY	ON	OFF
7	BANK A MONITORING	RESISTIVE	CAPACITIVE
8	BANK A SPRINKLER DELAY	ON	OFF

- NOTES :
- IF NO LOOP ISOLATION FUNCTION IS REQUIRED FIT LK1
 - THE EARTH TERMINALS MUST BE CONNECTED TO A CONVENIENT SYSTEM EARTH POINT
 - 'DATA' CONNECTION TYPE DEPENDS ON TYPE OF COMMUNICATION MODULE FITTED.
 - LSM INPUT IS NORMALLY CLOSED (OPEN FOR FAULT)
 - SPRINKLER DELAY TIME = 14 SECONDS
 - NO = NORMALLY OPEN

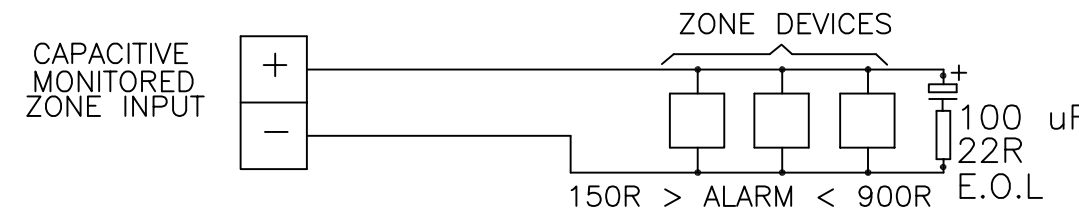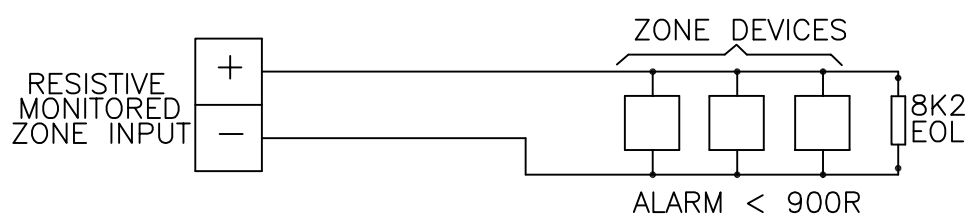

S6000 NO 16 WAY BOARD

<p>Protec Fire Detection plc Protec House, Churchill Way, Lomeshaye Ind. Est Nelson, Lancashire, U.K. BB9 6RT Tel (01282) 717171 Fax (01282) 717273</p>	SCALE	DESIGNED		
		DRAWN	D.R.REEVES	5.6.00
		CHECKED	N.HARLING	7-6-00
	APPROVED	P.Garnett	7-6-00	
TITLE S6000 16 WAY INPUT PCB DETAILS (WEFA273 ISSUE B)				
DRAWING No. PID189			JOB No.	
ISSUE	1			