



ISSUE	ALTERATIONS	DRAWN	APP'D	MOD No.	DATE
1	6300 WAS 6200&INTERFACE WAS SOUNDER	IWB	NH	A7361	18.12.02
2	WEFA311 C & LATER ADDED	BJR	NH	A9212	18.8.04

WEFA311 A&B

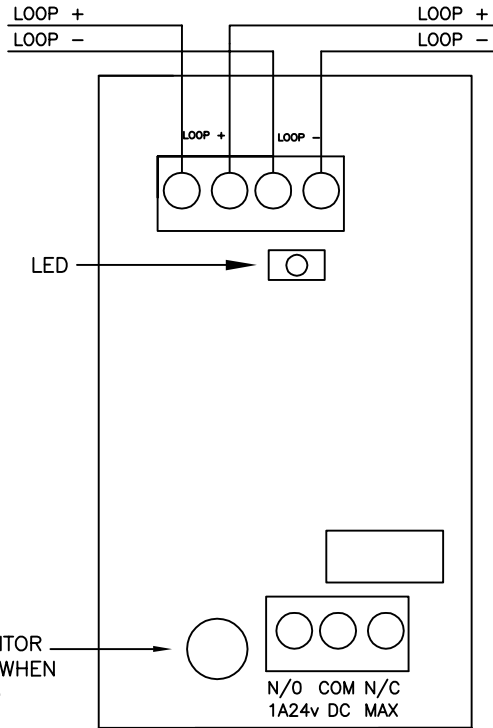

DO NOT EXCEED CONTACT RATINGS

WEFA311 C & LATER

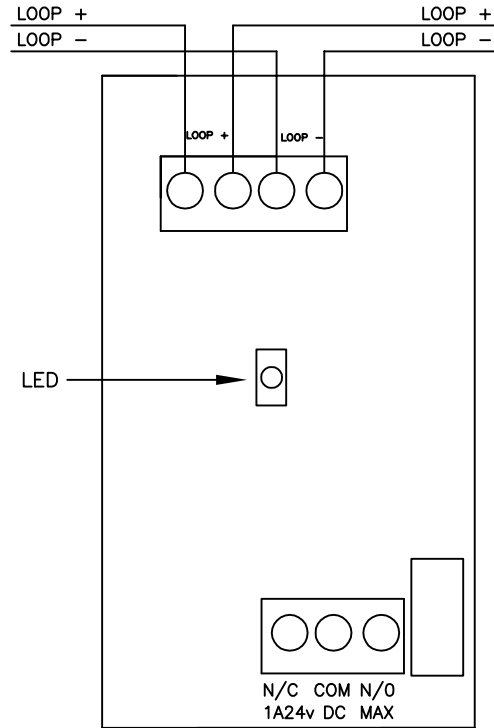


DO NOT EXCEED CONTACT RATINGS

Installation procedure for Protec 6000/CCO Variant products.
This document pertains to Protec 6000/CCO Variant products only.

Commissioning instructions.

Important. The Interface has a unique serial no. which will be used as part of the commissioning of the fire alarm system. It is necessary to remove one of the "peelable" bar code labels that has the product serial no. in bar code format, and place it on the commissioning booklet supplied with each 6400 or 6300 control panel. The bar code sticker should be placed on the commissioning booklet in the loop and address position in which the interface has been placed.
It is important that the serial no.s are not mixed otherwise the addressing of the interface will be wrong at commissioning.

Example: A CCO placed in Loop 1 Address 54

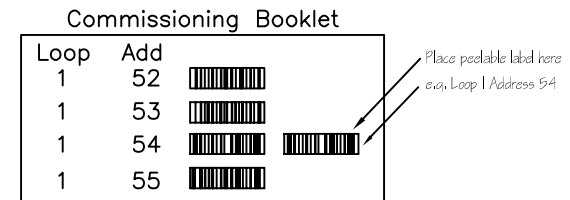

NOTE:
OUTPUT RELAY IS 1A 24V DC MAX

<p>Protec Fire Detection plc Protec House, Churchill Way, Lomeshaye Ind. Est Nelson, Lancashire, U.K. BB9 6RT Tel (01282) 717171 Fax (01282) 717273</p>	SCALE	DESIGNED	
	NTS	DRAWN	L.J.HOLT 16.9.02
		CHECKED	C.WHITAKER 18.9.02
	APPROVED	N.HARLING 18.9.02	
TITLE		S6000 CLEAN CONTACT OUTPUT WEFA311	
CLIENT			
DRAWING No.	PID221		JOB No.
ISSUE	2	PID	