

## Overview

The Protec 6000PLUS/HT/S is a loop powered fire sensor which reports thermal levels in its installed location to the fire alarm control panel. The sensor is also equipped with an integrated loop powered programmable electronic sounder and an integrated loop isolator.

## Technical Specification

Loop protocol	Protec Algo-tec™ 6000PLUS
Loop isolator fitted	Yes
Loop voltage range	18 to 27V Algo-tec™ Protocol
Loop average quiescent current (24V loop)	0.4mA
Loop average alarm current (24V loop )	5mA
Analogue values	Thermal
	Normal 80 to 180 bits
	Fault Low <25 bits
	Fault High>250 bits
Indications	On-board red indicating LED
Environmental operational limits	-10 to 50 degrees C ( 95% RH no condensation or icing )
Sounder Frequencies	Continuous 990Hz, Warble 730Hz to 990Hz, Pip 990Hz
Sounder synchronisation	Sounder synchronisation is achieved by panel control
IP rating	IP21C
Isolator Specification	Please see Protec DEL2110 for details

## Installation

- Base options: 6000PLUS/BASE LPCB Approved as part of product approval  
6000PLUS/FFBASE LPCB Approved as part of product approval  
28-075-01 (Plug and Play Fast Fix) LPCB Approved as part of product approval  
28-075-02 (Plug and Play Surface) LPCB Approved as part of product approval


Note: See individual information sheets for base wiring details.

- Install the detector in the base, turn firmly clockwise.

## Commissioning

- Each 6000PLUS detector has a unique serial number which will be used as part of the commissioning of the fire alarm system. It is necessary to remove one of the 'peelable ' bar code labels present on the product and place it in the commissioning booklet supplied with each Protec addressable control panel. The bar code sticker should be placed at the relevant loop and address position intended. It is important that serial numbers are not mixed otherwise the addressing of the 6000PLUS/HT/S will be incorrect when commissioned.
- Commission the device onto the system as detailed in the installation and commissioning manual for the fire alarm panel being used.

## 6000PLUS/HT/S Certification Details

EN Standards Compliance/ Approvals table		
 0 8 3 2		
Protec Fire Detection plc, Nelson, Lancs 10 <b>0832-CPD-1182</b>		
EN 54 - 3: 2001 + A1 + A2 Alarm devices – Sounder Type A: For indoor use 6000PLUS/HT/S	EN 54 - 5 Point type Heat detector Class A1/A2 6000PLUS/HT/S	EN 54 - 17: 2005 Short-circuit isolator 6000PLUS/HT/S
Technical data included in this datasheet DEL2089 Issue 4		

High sensitivity	Medium Sensitivity	Low Sensitivity
EN 54 - 5: 2000 + A1: 2002, Class A1	EN 54 - 5: 2000 + A1: 2002, Class A2	Not approved. Equivalent to EN 54 - 5: 2000 + A1 Class B

### 6000PLUS Locking Mechanism

The 6000PLUS detector range has a break off bridging piece shown in diagram one. Removing the small plastic bridging piece will enable the locking mechanism, and when the detector is fitted on a base, it will lock the detector. See diagram 1.

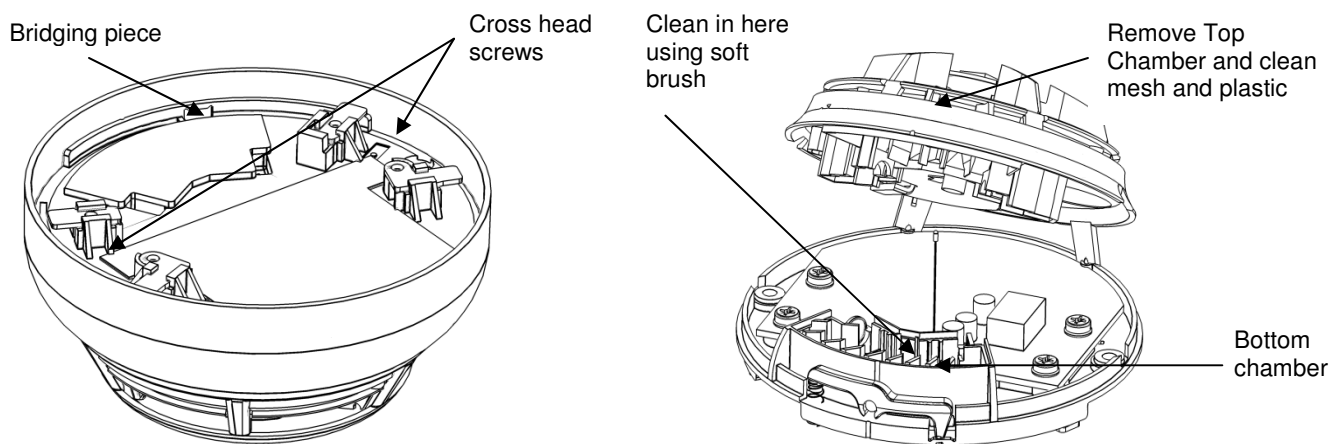


Diagram - 1 Locking bridging piece and cross head screw position

Diagram - 2 Outer case removed exposing optical chamber

### 6000PLUS/HT/S Service and Maintenance details

- Remove Detector from its base, check panel for Zone fault.
- Remove two cross head screws shown in diagram 1.
- Remove detector outer case. Note the position of thermistor, and remove mouldings with care so as not to damage thermistor.
- Remove Deflector and top chamber moulding, keeping mesh in place on top chamber. Ensure light pipe does not get lost, and be careful of the piezo connecting wires
- Clean all mouldings and mesh with a soft brush, clean inside the bottom chamber with soft brush (see Diagram 2).
- Clean thermistor and deflector with soft brush
- Clean detector outer case with a cloth.
- To rebuild, first fit deflector to top chamber noting arrow position to centre of optical chamber. Ensure mesh is flat to top chamber moulding. Ensure Light pipe is in place.
- Fit top chamber/deflector assembly to bottom chamber. Note: Be aware, small bead thermistor should be carefully inserted through central hole.
- Once top chamber/deflector is in place ensure thermistor is vertical and straight. The thermistor bead should be vertical, see diagram 3.
- Fit detector outer case, using light pipe as orientation guide.
- Fit the two cross head fixing screws, tighten sufficiently to compress mouldings, but be aware over tightening may strip the thread on the outer case. Visually inspect to ensure thermistor is visible in correct position.
- Fit back onto base.
- Once detector logged back onto panel, wait for confirmation LED flash, then apply heat to the detector ensuring activation of control panel. Confirm A/D value of thermal channel is correct. Test the operation of the integral sounder.
- Remove old service label and fit new label to detector.

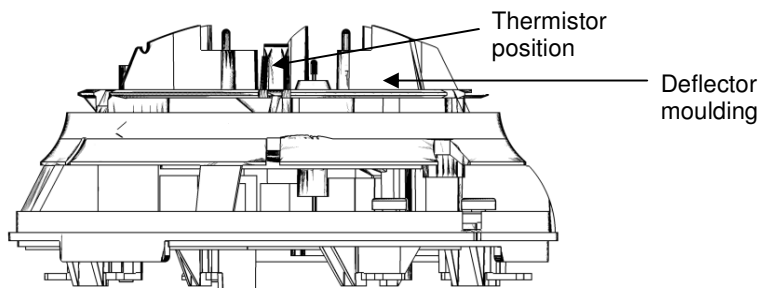


Diagram 3 - Re Assembly showing correct thermistor position

**Polar outputs and profiles (sounder)**

