


ISSUE	ALTERATIONS	DRAWN	APP'D	MOD No.	DATE
1	MINOR MODS	JH	RPO	A6025	12.7.01
2	NOTE ADDED/ECN 2364	BJR	RPO	B0881	13.6.06

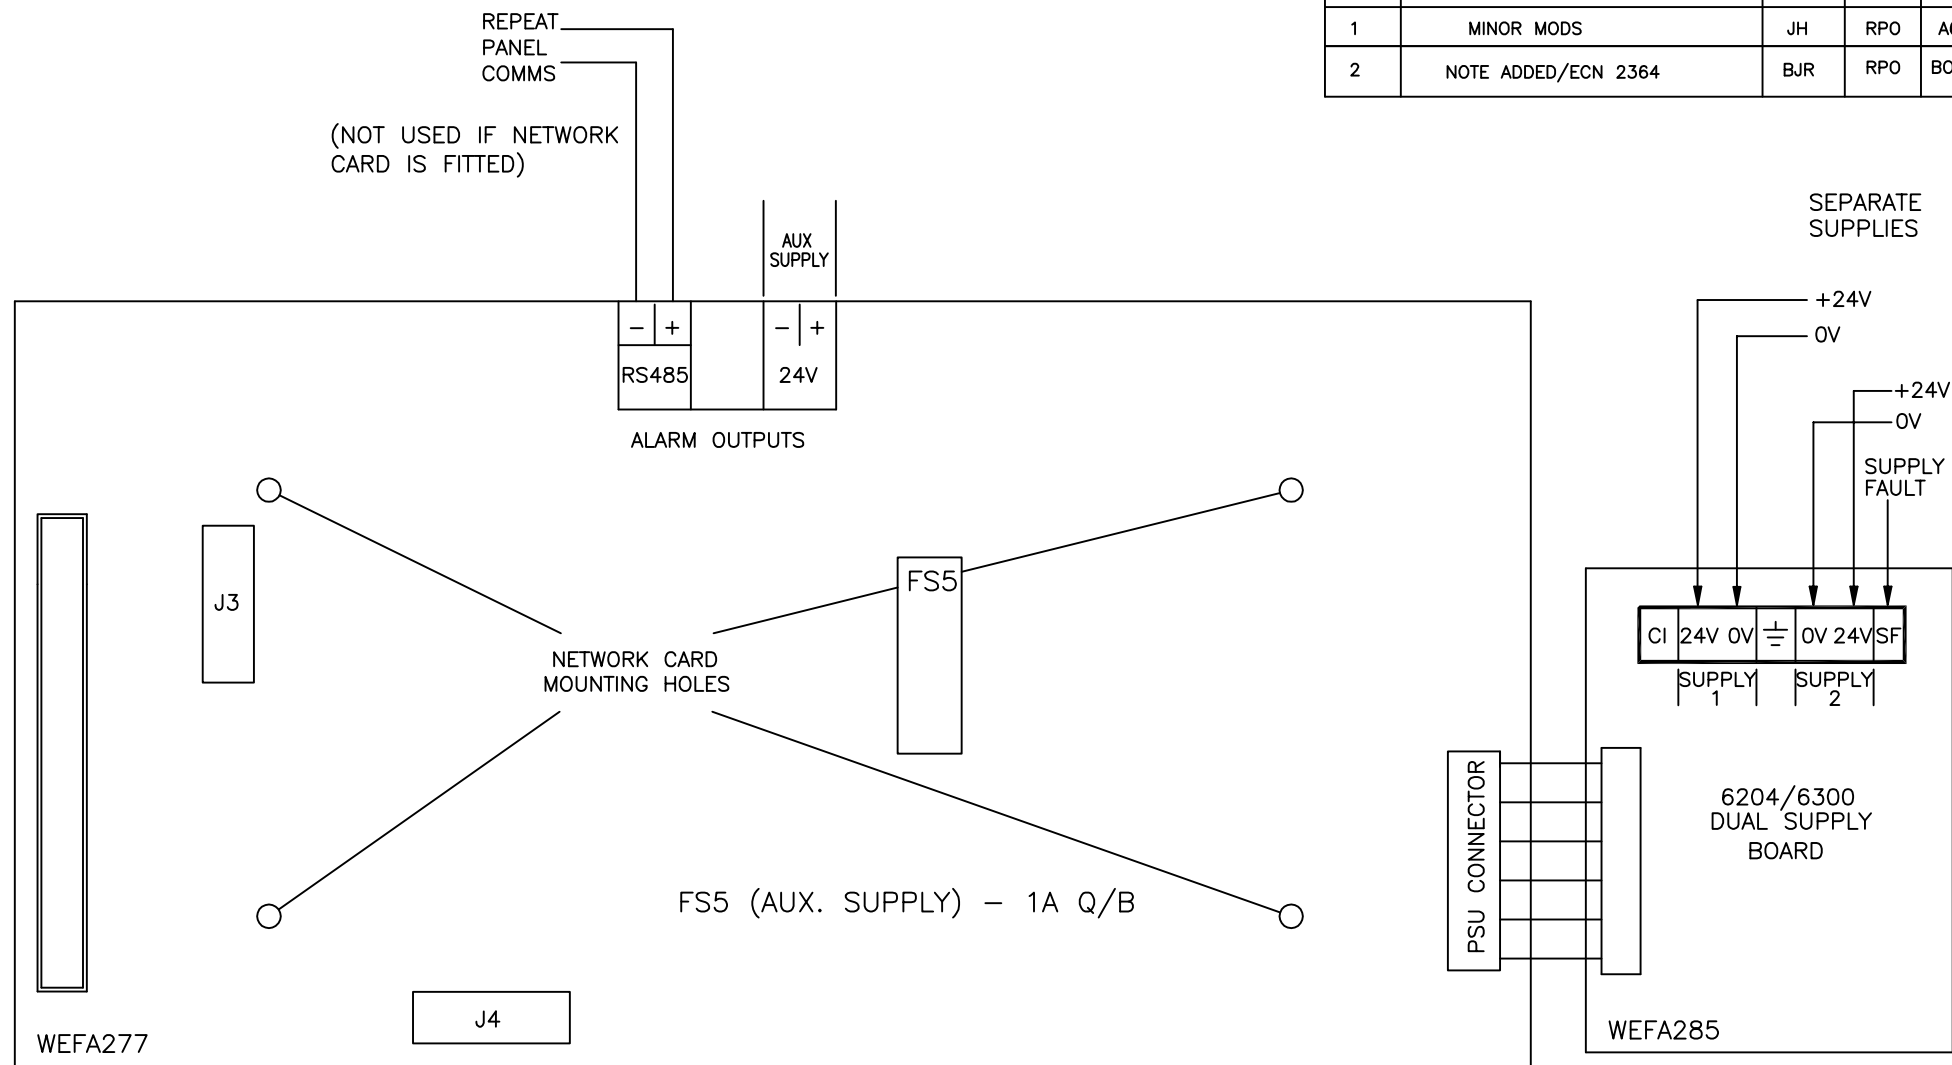

NETWORK CARD UPGRADE

- 1) FIT THE 4 STANDOFFS TO THE FIXING HOLES.
- 2) MOUNT THE NETWORK CARD ONTO THE STANDOFFS.
- 3) FIT POWER LEAD (SUPPLIED) FROM J3 TO NETWORK CARD J1.
- 4) FIT 232 LEAD (SUPPLIED) FROM J4 TO NETWORK CARD J4.
- 5) USE THE RS485 TERMINALS ON THE NETWORK CARD AND NOT THOSE ON THE TERMINAL BOARD.

FITTED WHEN USING
REMOTE CHARGER

<p>Protec Fire Detection plc Protec House, Churchill Way, Lameshaye Ind. Est Nelson, Lancashire, U.K. BB9 6RT Tel (01282) 717171 Fax (01282) 717273</p>	SCALE	DESIGNED		
	NTS	DRAWN	J HACKING	28.3.01
		CHECKED	R.P.OLDLAND	28.3.01
		APPROVED	P.DEW	28.3.01
TITLE		6204/6300 REPEAT TERMINAL BOARD CONNECTIONS		
DRAWING No.		PID202		JOB No.
ISSUE		2		