



ISSUE	ALTERATIONS	DRAWN	APP'D	MOD No.	DATE
1	ADDED 6400	DRR	PD	A4761	16.2.00
2	SUPPLY FAULT CONTACT ADDED, UNDER ECN NO. 2255	IS	RPO	B0414	25.10.5

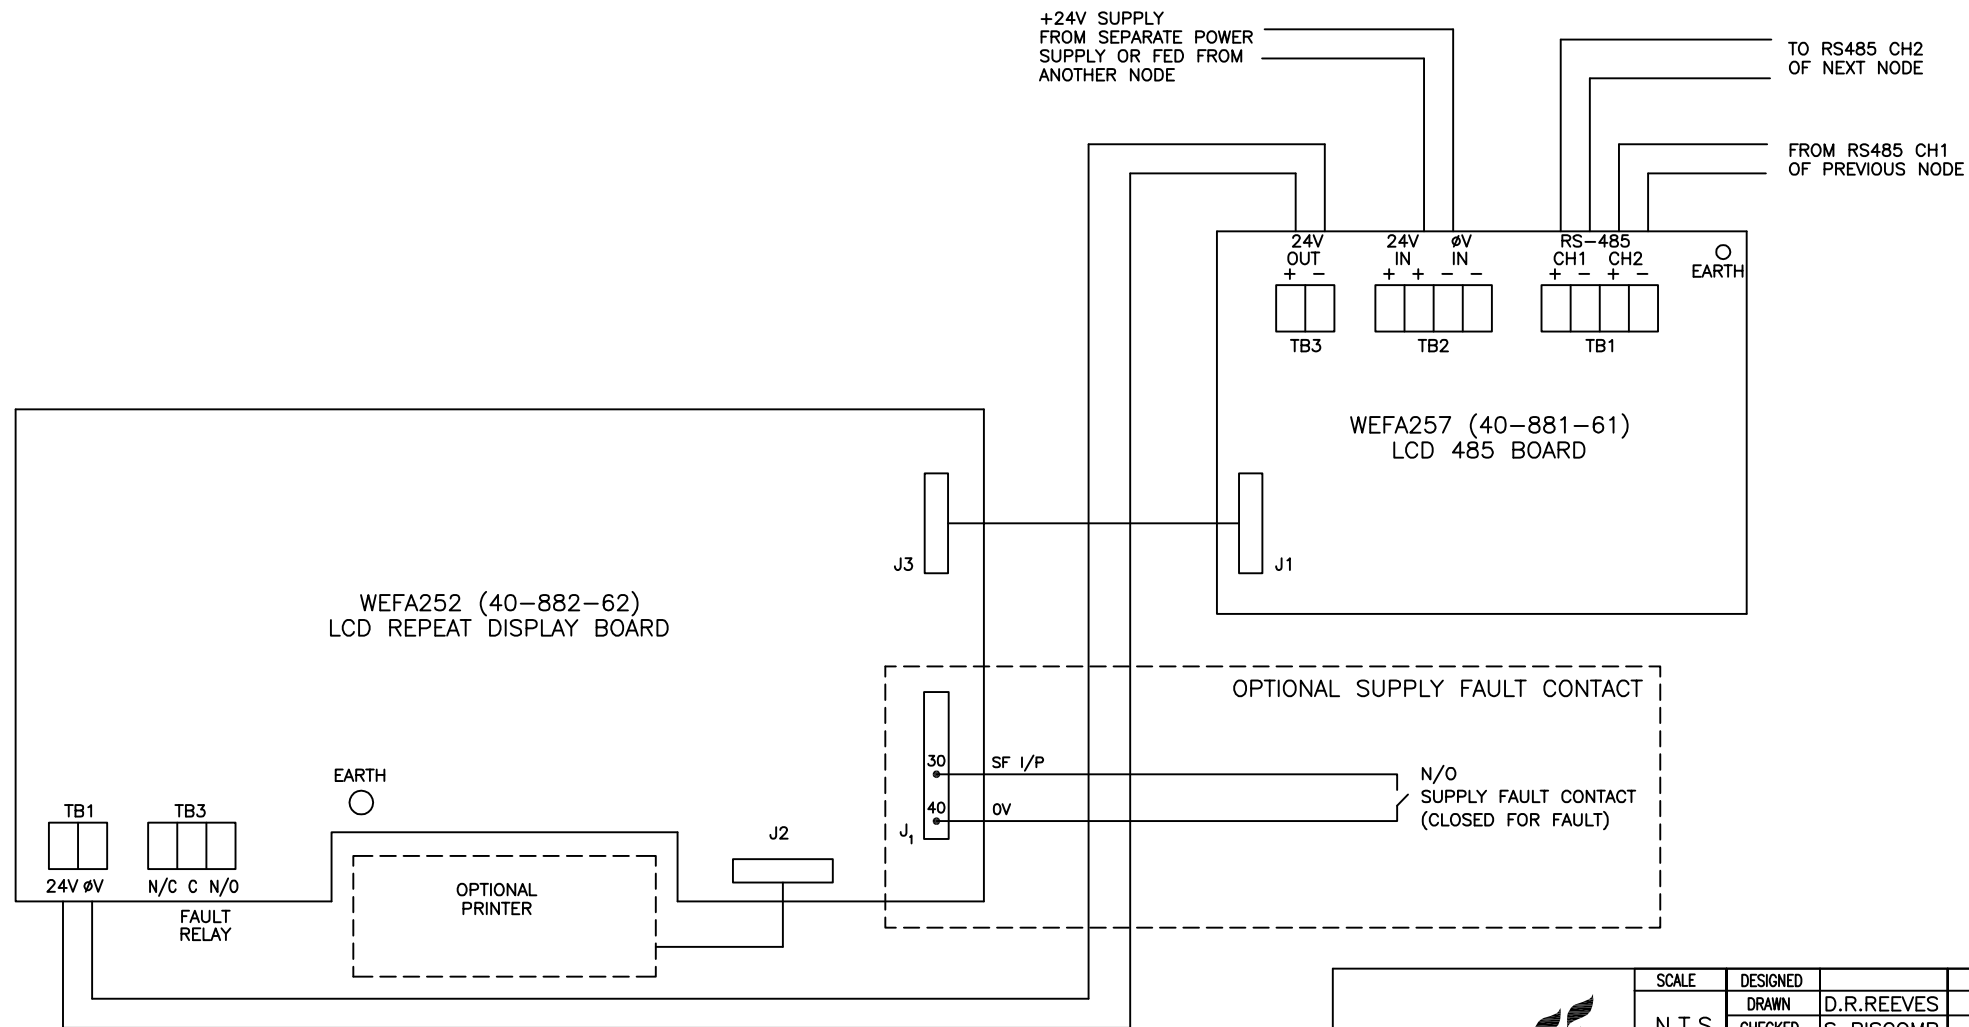

 Protec Protec Fire Detection plc Protec House, Churchill Way, Lomeshaye Ind. Est Nelson, Lancashire, U.K. BB9 6RT Tel (01282) 717171 Fax (01282) 717273	SCALE	DESIGNED		
	N.T.S.	DRAWN	D.R.REEVES	10.7.98
	CHECKED	S BISCOMB	10.7.98	
	APPROVED	P DEW	10.7.98	
TITLE				
CONNECTIONS FOR 5400/6400 RDN				
DRAWING No. PID151			JOB No.	
ISSUE	0	1	2	