FC460 Detectors

Product Application & Design Information

FC-D-A

Doc. version 2 8. May 2012 © FIRECLASS. Hillcrest Business Park, Dudley, West Midlands, DY2 9AP, UK, 2012

Contents subject to change without notice.

All rights to this documentation, including the contents of the online help, are reserved, in particular but not limited to the rights of copying, distribution and translation.

No portion of this documentation, including the online help, may be reproduced, edited, copied or distributed in any form without prior written authorization from FIRECLASS. Use of the data medium provided with this product is restricted to copying the software for the purpose of data backup only.

Contents

1	About this Guide	5
1.1	What this Guide Covers	5
1.2	What this Guide does not Cover	
2	Introduction to the Detectors	6
2.1	Detection Capability Suffixes	6
2.2	Replacement Detector Compatibility	
2.3	Functionality	6
2.3.1	Self Monitoring	6
2.3.2	Self Testing	7
2.3.3	Status Indicator	7
2.3.4	Remote LED	7
2.3.5	Functional Base Compatibility	7
2.3.6	Threshold Compensation	7
2.4	Address Programming	
2.5	Approvals	7
3	Detector Mode Selection	
3.1	Selection Guidelines	8

Contents FC460 Series Detectors

FC460 Series Detectors 1 About this Guide

1 About this Guide

This guide is aimed at suitably qualified technicians experienced in the design and specification of fire detection and alarm systems, who have also received training.

1.1 What this Guide Covers

This guide is for use when designing a fire detection system using addressable detectors, or replacing addressable detectors in an existing system.

Guidance notes cover the features of the detectors, pointers to information on detector choice, and detector siting.

This guide is an overall guide to the FC460 addressable detectors.

This guide only includes information common to all FC460 detectors. There are more specific leaflets available covering particular types of FC460 detector. These specific leaflets include ordering information.

1.2 What this Guide does not Cover

This guide does not provide installation information. This is because the detectors simply dock to detector bases, and installation details are provided for the bases.

Operating modes of the detectors are set using system application and configuration tools, so only a brief overview is provided in this guide.

This guide does not provide information where this is covered by local regulations. For example specific detector siting stipulations are expected to be covered by local regulations, so they are excluded from the guide (however brief guidelines are provided).



Reference Guides

There are a number of system level guides available for download from the fireclass.co.uk website. These support the design, installation and use of fire alarm systems.

2 Introduction to the Detectors

The detectors are for use in an addressable system which uses the FireClass Digital Protocol, where a number of detectors are placed in key areas around the building.

The function of the detector is simply to quantify environmental variables and provide the resulting numerical value to the fire alarm control panel.

The fire alarm control panel processes the detector values and assesses whether an alarm needs to be issued.

Depending on the detector variant, the environmental variables monitored will be either one or a combination of the following:

- Temperature.
- Smoke density.
- Concentration of Carbon Monoxide (CO).

Figure 1 shows a typical detector and highlights some of the features that are discussed later in the document.

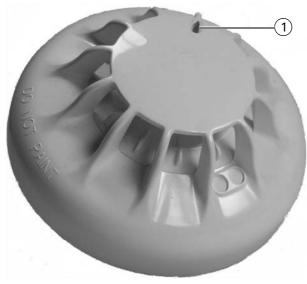


Fig. 1: Detector Communications 1–Status Indicator

2.1 Detection Capability Suffixes

The capabilities of detectors are indicated with a suffix to the detector number. So for example the FC460H is a heat only detector, while the FC460P is an optical smoke detector. These suffixes are shown in Table 1.

Suffix	Heat	Smoke	СО
PH	✓	√(optical)	
Р		√(optical)	
Н	✓		
PC	✓	√(optical)	✓

Table 1: Suffixes

2.2 Replacement Detector Compatibility

The FC460 series detectors are compatible with the FC400 series detectors.



Reference Guides

Refer to the detector base product information document for compatible bases and installation/mounting of bases.

2.3 Functionality

Table 2 shows the types of functionality that are present in the various detectors.

	De	tecto	r Typ	oes
Functionality		460 S	eries	•
	РН	P	Н	PC
Self Monitoring	✓	✓	✓	✓
Self-Test	✓	✓	✓	✓
Status Indicator	✓	✓	✓	✓
Remote LED	✓	✓	√	√
Functional Base Compatibility	√	√	√	√
Threshold Compensation	✓	✓		✓

Table 2: Functionality of the Detectors

2.3.1 Self Monitoring

"Self Monitoring" refers to the characteristics or design features of the detector that allow faults to be detected. For the various sensors these are as follows:

- For the heat (temperature) sensor there is a normal output level to be expected, around "ambient" temperature
- For the CO sensor, the integrity of the sensor cell is constantly checked.
- For the optical (smoke) sensors, the optical chamber is periodically stimulated.

2.3.2 Self Testing

The detectors support a self-test feature.

For the self test, fire conditions are artificially simulated within the detector. The detecting sensors will then react as if there were an actual fire.

2.3.3 Status Indicator

This indicates as follows:

- Yellow flashing indicates a detector fault. However, this behaviour can be enabled/disabled as per the settings in the panel configuration software.
- Red flashing indicates normal operation (flashes on detector poll). However, this behaviour can be enabled/ disabled as per the settings in the panel configuration software.
- Red continuous indicates detector in alarm.

2.3.4 Remote LED

The detectors are capable of driving a Remote LED.

2.3.5 Functional Base Compatibility

The detectors are compatible with the range of sounder bases.

2.3.6 Threshold Compensation

The detectors support the ability to compensate for the affects of contamination due to dust and dirt. This prevents an increase in the likelihood of false alarms, extending the operational life of the detector. This function applies only to those detectors with a smoke sensor.

2.4 Address Programming

The detectors are addressed by using the FC490ST Loop Service Tool.



Reference Documents

For further information on how to program the address into the detectors, refer to the FC490ST Loop Service Tool User Instructions.

2.5 Approvals

The detectors comply with the following standards:

- Construction Products Directive (CPD), fulfilling the requirements of:
 - EN 54-5:2000 + A1:2002 Heat Detectors
 - EN 54-7:2000 + A1:2002 + A2:2006 Smoke Detectors
- CEA 4021 (2003) MultiSensor Detectors
- VdS 2806 (1999) Fire Gas Detectors
- Product family standard EN 50130-4 in respect of Conducted Disturbances, Radiated Immunity, Electrostatic Discharge, Fast Transients and Slow High Energy
- EN 61000-6-3 for Emissions

3 Detector Mode Selection FC460 Series Detectors

3 Detector Mode Selection

3.1 Selection Guidelines

Your choice of detector will be determined by the demands of the application.

Table 3 is for guidelines only and specific situations are likely to require variations on the suggested detector types. Real situations may require detector combinations to cover all likely risks.

Tables 3 and 4 are for guidelines only and specific situations are likely to require variations on the suggested detec-

tor types. Customer knowledge of relative impact of false alarm vs undetected fires should be considered.

In Tables 3 and 4, the Night and Day columns represent low false alarm risk and high false alarm risk. Although this usually follows a day/ night pattern, it may be configured for any time. For example the car deck of a ferry would be configured for Day during vehicle loading and Night once all the passengers had left the car deck, thus achieving optimum protection for that area.

Environment	Very cl	Very clean and dry	>	Benign Regula	Benign moderately clean, Regulated temperature	ely clean, rature	Dirty-sn day	Dirty-smoky during the day	ng the	Dusty a	Dusty and/or humid	mid	Hot and use	Hot and smoky when in use	hen in	Open areas	reas	
For example	Clean room, Data proces	Clean room, Data processing suite	suite	Offices industr Passen	Offices, Hospitals, Light industrial, Residential, Passenger cabin	, Light ntial,	Wareh fork-lift: industri	Warehouse with diesel fork-lifts etc. Heavy industrial ferry (car deck)	diesel // ar deck)	Livesto	Livestock pen mill, Laundry, Changing room	ill, ng room	Kitchen, E Test beds	Kitchen, Engine room, Test beds	oom,	Atrium, Oil rigs,	Atrium, Theatre, Hanger, Oil rigs, Turbine hall	langer, all
	Туре	Mode		Туре	Mode		Туре	Mode		Туре	Mode		Туре	Mode		Туре	Mode	
Fire loading		Night	Day		Night	Day		Night	Day		Night	Day		Night	Day		Night	Dау
Electronic equipment Electrical swithgear Electric motors Cable conduit	РН. Р	E(H) A(H)	B(H) A(H)	PH.	B(H) A(N)	B(N) A(N)	PH.	E(N)	A(H)	Heat	Q	Ч	Heat.	9	×	PH.	B(H)	B(H)+X
Fabrics, Clothes Soft furnishings Paper, Cardboard Plastic foams Animal bedding Wood shavings etc	PH.	B(H)	A(N)	PH.	B(H)	A(N)	PH.	E(N)	A(L)	PH.	B(L)	A(L)	Heat	CR	×	PH.	B(H)	B(H)+X
Flammable liquids Plants solvents Flammable glasses Unstable chemicals	РН. Р	E(H) A(H)	E(H) A(H)	PH.	E(H) A(N)	E(N) A(N)	PH Heat	E(N)	Q	PH Heat	B(L)	Α(L) F	Heat	D	Ð	PH.	B(H)	B(H)+X
Food stuffs General organic waste Animal fodder Wooden structures Solid fuels	PH.	Е(Н)	E(N)	РН.	E(N) A(N)	E(N) A(N)	РН. Heat	E(N) D	A(L) F	P Heat	Α(L) F	A(L) F	Heat	D	9	PH.	B(H)	B(H)+X
Plastic Chemicals Machinery Building materials Unknown contents	H.	Е(Н)	E(N)	РН. Р Неаt	E(H) A(N) D	E(N) A(N)	PH. P Heat	B(N) A(L) D	E(L) A(L) D	P Heat	A(L)	A(L)	Heat	D	ŋ	PH.	B(H)	В(Н)+Х

(H) = High sensitivity, (N) = Normal sensitivity, (L) = Low sensitivity Bold text indicates most likely detector/mode to meet user's requirements. Letters in brackets represent recommended sensitivity settings A=Optical, B=HPO, C=Optical and Fixed Heat 60C (EN54 A2S), D= Heat Rate of Rise (EN54 A1R) /Normal Ambient RoR (EN54A1R) E = HPO & Fixed Heat 60C (EN54 A2S) F = Fixed Heat 60C (EN54 A2S), G = High Ambient RoR (EN54 CR), X = Callpoint protection Table 3: Variations on Suggested Detector Types

Product Application & Design Information Doc. version 2

FC460 Series Detectors 3.1 Selection Guidelines

Open areas	Atrium, Theatre, Hanger, Oil rigs, Turbine hall	Mode	Day	0 ←	0	o ⊢	o –	o –
Oper	Atrium, Hanger Turbi	Ň	Night	o –	o –	o –	o ←	o –
smoky n use	ingine t beds		Пау	1 0	ı	1	1	-
Hot and smoky when in use	Kitchen, Engine room, Test beds	Mode	Night	• 0	1	-	-	-
nd/or iid	k pen I, dry, g room	ge Se	Day	- 0	0	1	- 0	- 0
Dusty and/or humid	Livestock pen mill, Laundry, Changing room	Mode	Night	0 -	0 -	-	o –	o ←
moky the day	moky the day use with c-lifts etc. idustrial ir deck)		Дау	- 0	0	-	- 0	- 0
Dirty-smoky during the day	Warehouse with diesel fork-lifts etc. Heavy industrial ferry (car deck)	Mode	Night	o –	o –	-	o –	o –
Benign moderately clean, Regulated temperature	Offices, Hospitals, Light industrial, Residential, Passenger cabin	Mode	Day	0 ←	0 ←	0 -	- 0	- 0
Benign m clean, R tempe	Offices, H Light in Resid Passeng	M	Night	0 ←	0 ←	0 ←	o ←	o ←
Very clean and dry	Clean room, Data processing suite	Mode	Day	0 -	0 -	o ←	- 0	• 0
Very clea	Clean Data pro	Mo	Night	0 ←	0 ←	0 -	0 ←	0 -
Environment	For example	Fire loading		Electronic equipment Electrical switchgear Electric motors Cable conduit	Fabrics, clothes Soft furnishings Paper, cardboard Plastic foams Animal bedding Wood shavings etc	Flammable liquids Plants Solvents Flammable glasses Unstable chemicals	Food stuffs General organic waste Animal fodder Wooden structures Solid fuels	Plastic Chemicals Machinery Building materials Unknown contents

Table 4: Type PC Variants; Bold text indicates most likely detector/mode to meet user's requirements. Mode 0 - Universal Mode 1 - High Resilience

FC460 Series Detectors 3.1 Selection Guidelines

Italy

FIRECLASS
Via Gabbiano 22
Zona Industriale, S. Scolastica
64013 Corropoli (TE)
Italy
FireclassSales@tycoint.com
www.fireclass.co.uk

United Kingdom

FIRECLASS
Hillcrest Business Park
Cinder Bank
Dudley
West Midlands
DY2 9AP
United Kingdom
FireclassSales@tycoint.com

www.fireclass.co.uk

Further information about FIRECLASS can be found on the Internet at www.fireclass.co.uk

Company stamp	

